



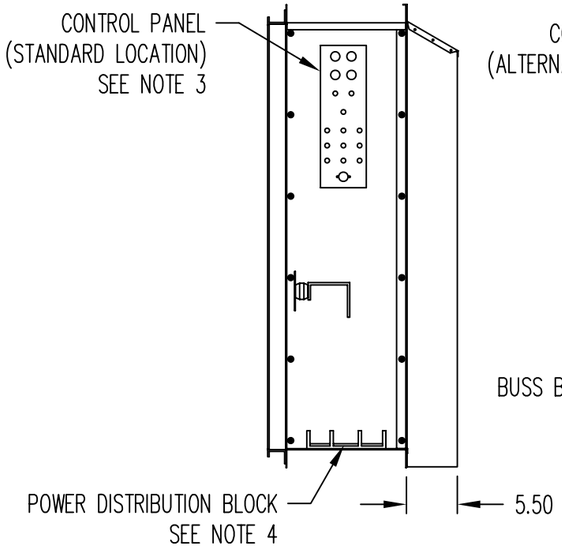


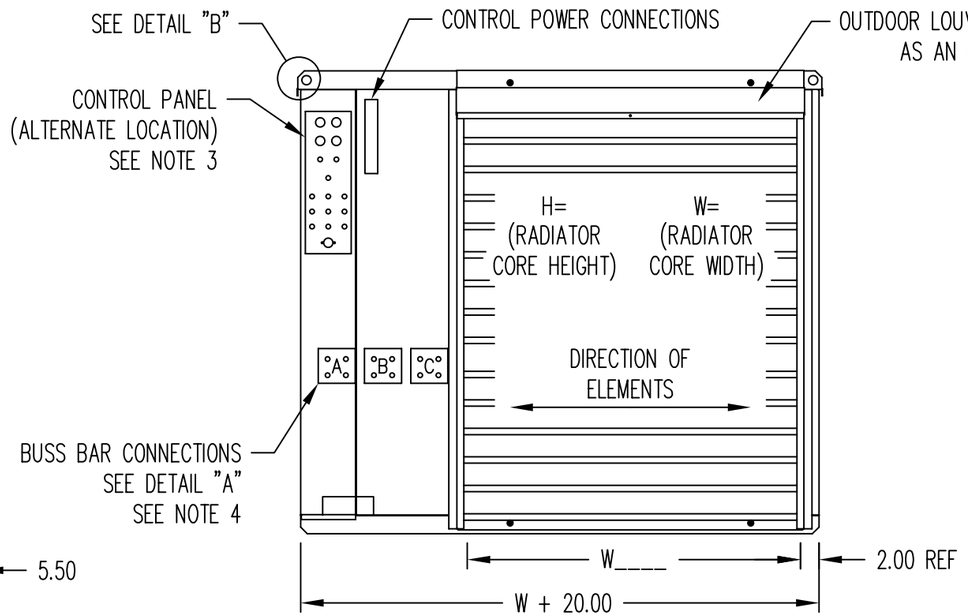

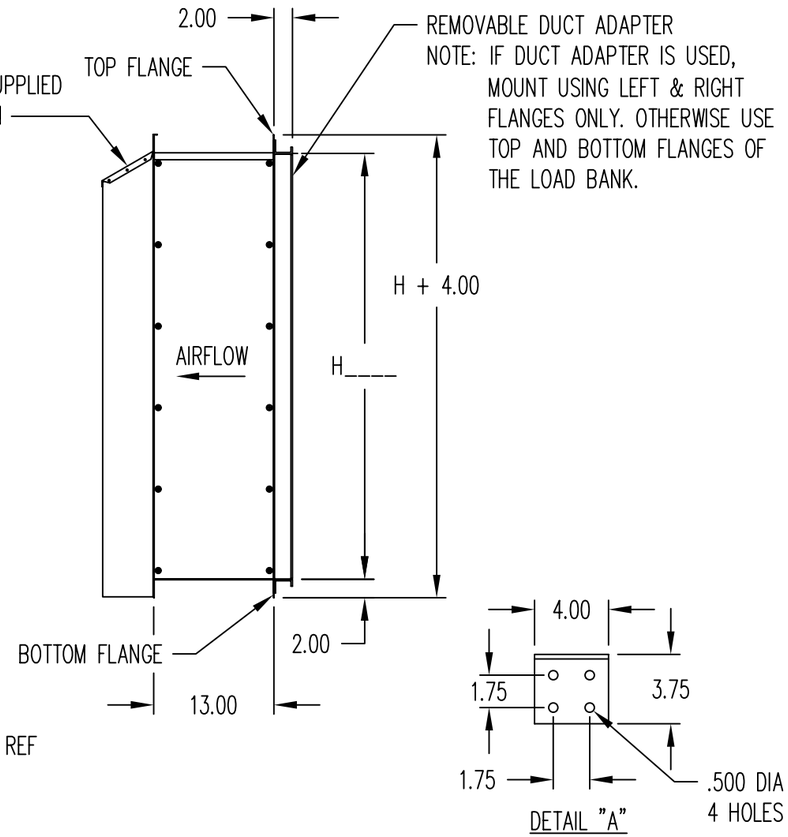

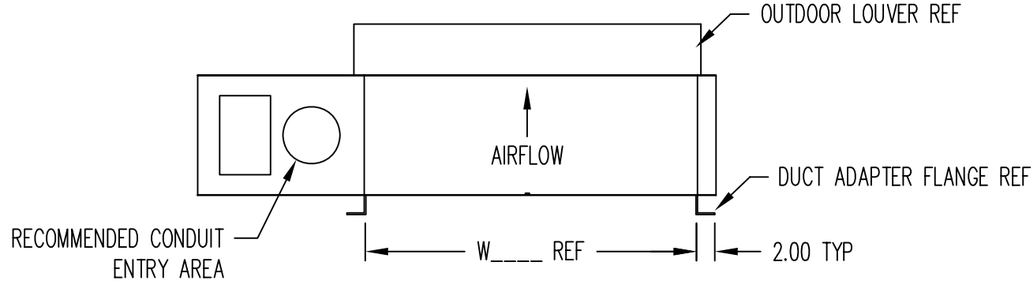

BOTTOM VIEW

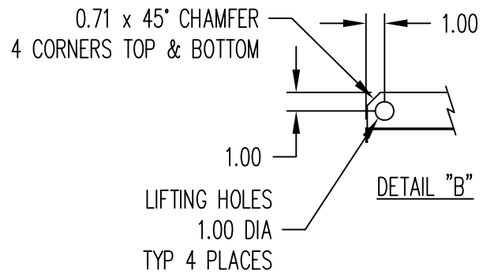

4. POWER DISTRIBUTION BLOCK OR BUSS BARS SUPPLIED DEPENDING ON LOAD BANK VOLTAGE AND KW.
3. THE CONTROL PANEL IS NOT AT THIS LOCATION IF IT IS SUPPLIED OPTIONALLY AS A REMOTE 19" RACK MOUNT COMPONENT OR IF IT'S MOUNTED ON THE EXHAUST SIDE OF THE LOAD BANK AS SHOWN ALTERNATELY.
2. ALL DIMENSIONS ARE APPROX.
1. WEIGHT:

NOTES:

FOR APPLICATION ENGINEERING USAGE ONLY

THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION OF AVTRON MFG., INC. AND MAY NOT BE DISCLOSED TO OTHERS OR USED FOR MANUFACTURING PURPOSES WITHOUT THE WRITTEN CONSENT OF AVTRON MFG.

ECN NO.	REV LET.	CHANGE	CHG'D	CHK'D
CE640	G	ADDED "BOTTOM VIEW". J.FLAUTO	11-13-06	D.STACK
CD980	F	ADDED CHAMFERS FACKELMANN TO TOP & BOTTOM RAILS, ADDED LOUVER DEPTH DIMENSION	3/15/05	J.W.EMERY
CD734	E	REV'D & REDRAWN FACKELMANN PER ECN	6/28/04	K.KUK

DRAWN	E.JAMIOL	DATE 5/13/92
CHECKED		
APPROVED	D.BOHRER	SCALE 1/16

AVTRON MANUFACTURING, INC.
INDEPENDENCE, OH

LOAD BANK
K711

DRAWING NUMBER
SB2203
SHT 1 OF 1
OUTLINE DRAWING